




MA/CG Novec 1230 ENGINE ROOM WORKSHEET

Fireboy-Xintex will certify the volume of the engine room from manufacturer CAD drawing including volume calculations, or from a completed Engine Room Volume Worksheet

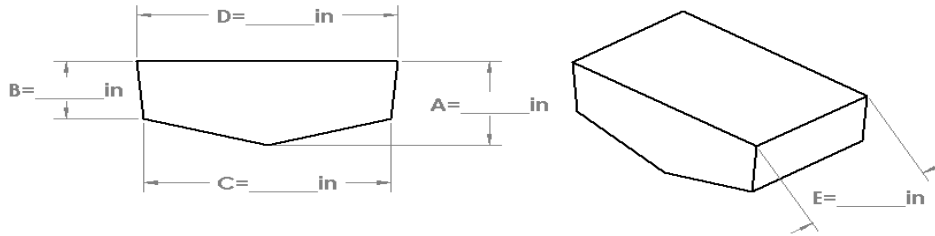

MAKE _____ MODEL _____ YEAR _____

MEASURED BY _____ Signature _____ Date _____
 Print _____

Gross Engine Room Volume

$$\frac{\text{A}}{\text{in}} + \frac{\text{B}}{\text{in}} = \text{in} \div 2 = \text{in} \times \frac{\text{C}}{\text{in}} = \text{in}^2$$

$$\frac{\text{D}}{\text{in}} - \frac{\text{C}}{\text{in}} = \text{in} \div 2 = \text{in} \times \frac{\text{B}}{\text{in}} = + \text{in}^2$$

MODEL REQUIRED: _____

$$\begin{aligned} &\downarrow \\ &\text{in}^2 \\ &\times \text{E} \\ &\downarrow \\ &\text{in}^3 \\ &+ \text{Additional Volume(s)} \\ &\downarrow \\ &\text{in}^3 \\ &\div 1728 \end{aligned}$$

MA2 Maximum Protected Volume = 1800 cu.ft.
 CG2 Maximum Protected Volume = 1000 cu.ft.

Gross Engine Room Volume = _____ ft³

Tank Description	Fixed Tank Deductions - Fuel - Water- Waste				
_____	_____ in	×	_____ in	×	_____ in = _____ in ³ ÷ 1728 = _____ ft ³
	Length		Width		Depth
_____	_____ in	×	_____ in	×	_____ in = _____ in ³ ÷ 1728 = + _____ ft ³
	Length		Width		Depth
_____	_____ in	×	_____ in	×	_____ in = _____ in ³ ÷ 1728 = + _____ ft ³
	Length		Width		Depth
					Gross Tank Volume = _____ ft ³

Gross Engine Room Volume - Gross Tank Volume = Net Engine Room Volume

_____ ft³ - _____ ft³ = _____ ft³

USCG & ABYC ALLOWS DEDUCTIONS FOR FIXED TANKS BY BOAT MANUFACTURERS ONLY. NOTE: ENGINE VOLUME CANNOT BE DEDUCTED

Engine Room Area

$$\frac{\text{_____ in}}{D} \times \frac{\text{_____ in}}{E} = \text{_____ in}^2 \div 144 = \text{_____ ft}^2$$

Models 025-1800 Maximum Approved Area: 352.7 ft²

Engine Room Height

$$\frac{\text{_____ in}}{A} \div 12 = \text{_____ ft}$$


Models 025-300 Approved Ceiling Height: 2.0 ft to 11.3 ft

Discharge Nozzle Height

Distance from ceiling to discharge nozzle _____ in

Maximum Approved distance: 24 in

Location of Cylinder

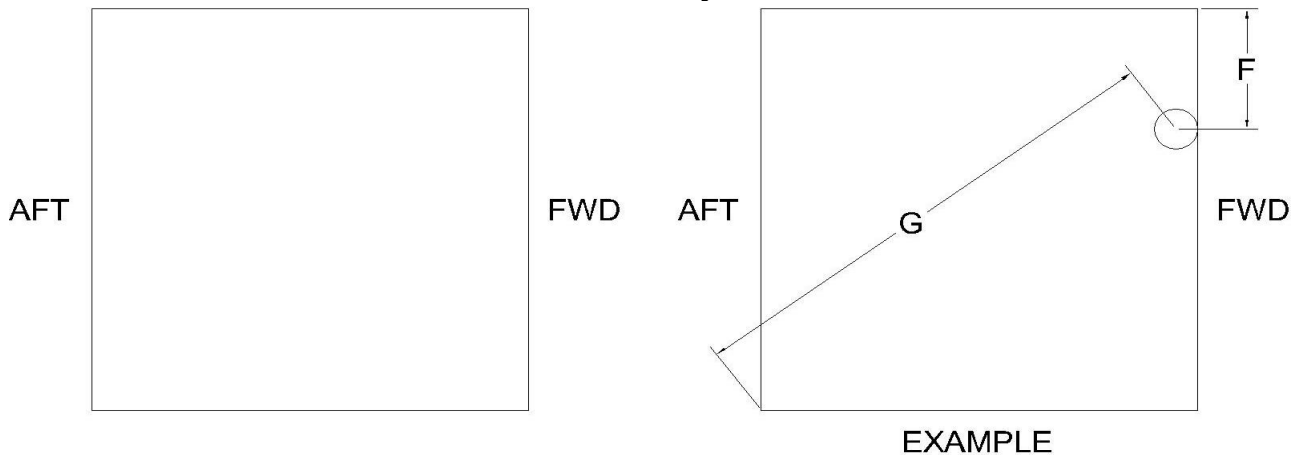

Indicate Cylinder Location in blank diagram above

F = Distance to nearest wall (Informational Only) _____ ft
F

G = Distance to furthest corner (Maximum Radial Reach) _____ ft
G

Models 025-1800 Maximum Approved Radial Reach (G): 21.0 ft